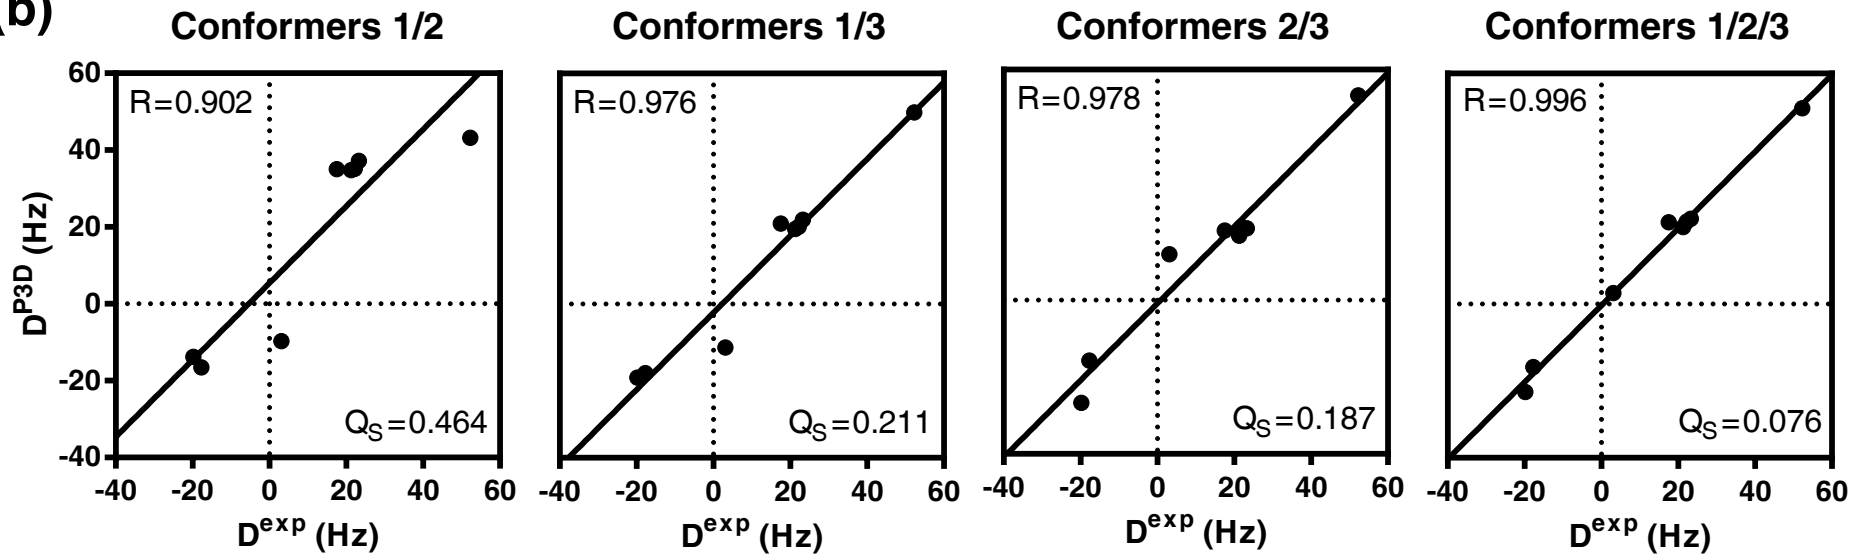


(a)

	RDCs (Hz)							
	CH1	CH2	CH3	CH4	CH5	CH9	CH10	CH11
Conformer 1	34.53	34.65	36.78	34.34	43.22	-13.40	-11.59	-16.83
Conformer 2	53.20	48.10	51.00	49.61	42.23	-25.31	52.39	-8.60
Conformer 3	-0.53	1.27	0.60	-1.66	59.48	-27.44	-10.79	-19.65
Conformers 1/2 (w. a. 97/3%)	35.09	35.05	37.21	34.80	43.19	-13.76	-9.67	-16.58
Conformers 1/3 (w. a. 59/41%)	20.16	20.96	21.95	19.58	49.89	-19.16	-11.26	-18.00
Conformers 2/3 (w. a. 36/64%)	18.81	18.13	18.74	16.80	53.27	-26.67	11.95	-15.67
Conformers 1/2/3 (w. a. 29/22/49%)	21.46	21.25	22.18	20.06	50.97	-22.90	2.88	-16.40
Experimental	22.23	17.53	23.32	21.3	52.25	-19.79	3.12	-17.74

(b)**(c)**